Sump & Utility Pumps



BARNES[®]

Manual & Automatic, Submersible Sump /Effluent


DISCHARGE1½" NPT, Female, Vertical LIQUID TEMPERATURE 104°F (40°C) Continuous MOTOR HOUSING Cast Iron PUMP BODY & STRAINER Thermoplastic side. Balanced, ISO G6.3 Material Cast Iron SHAFTStainless Steel **O-RINGS** Buna-N HARDWARE 300 Series Stainless Steel PAINT Air Dry Enamel SEAL: Design Single Mechanical, Type 21 Material Carbon/Ceramic/Buna-N Hardware -300 Series Stainless CORD ENTRY...... 10 ft. (3m) or 20 ft. (6m) Cord with plug and Pressure Gromment for sealing and strain relief UPPER BEARING...... Single Row, Ball, Oil Lubricated LOWER BEARING...... Single Row, Ball, Oil Lubricated MOTOR: Design Oil Filled Insulation.....Class B Includes thermal overload protection in motor **LEVEL CONTROL:** SP33 None SP33A Wide Angle, Mechanical, 10 ft (3m) cord or 20 ft (6m) cord SP33VF......Vertical Float, PVC, Snap Action, 10 ft (3m) cord or 20 ft. (6m) cord SP33D......Diaphragm switch, pressure operated, Snap Action, normally open, 10 Ft. (3m) cord **MINUMUM SUMP DIA:**

SP33A 18" (457mm)

SP33D......11" (279mm)

NOTE...... GFCI Compatible to Comply with NEC

SP33. SP33VF




Series: SP33, 1/3HP, 3450RPM, 60Hz



DESCRIPTION:

GENERAL PURPOSE PUMP FOR RESIDENTIAL AND LIGHT INDUSTRIAL SUMP APPLICATIONS

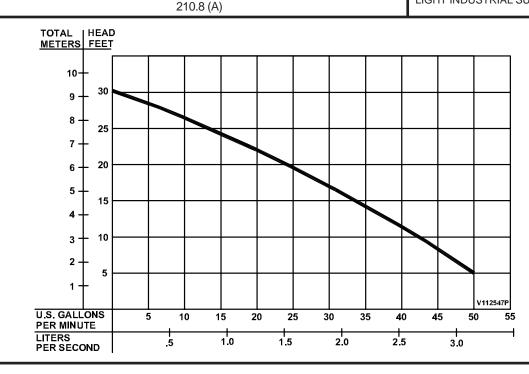

Testing is performed with water specific gravity of 1.0 @ 68°F (20°C), other fluids may vary performance




PUMPS & SYSTEMS

SECTION 1A PAGE 3 DATE 9/10



www.cranepumps.com

Sump & Utility Pumps

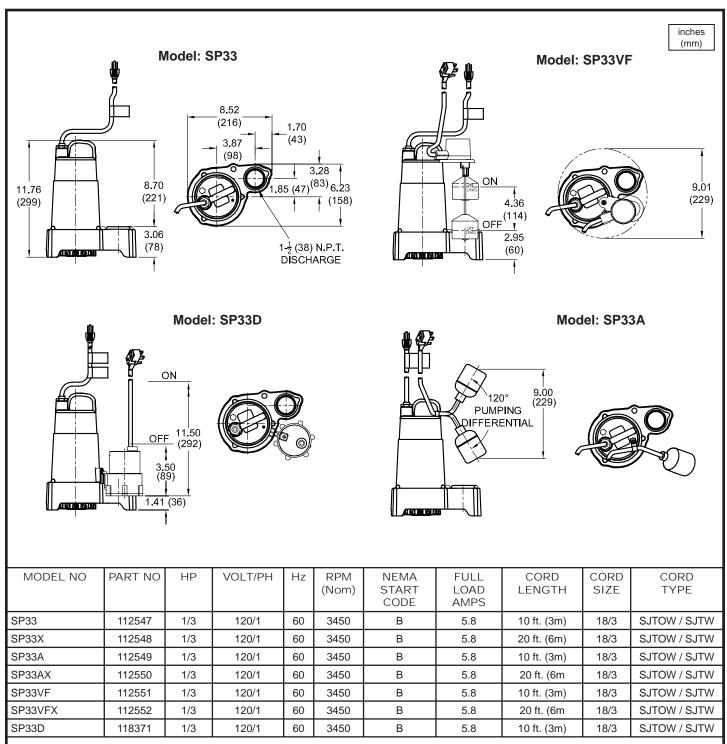

IMPORTANT!

- 1.) PUMP MAY BE OPERATED "DRY" FOR EXTENDED PERIODS WITHOUT DAMAGE TO MOTOR AND/OR SEALS.
- 2.) THIS PUMP IS NOT APPROPRIATE FOR THOSE APPLICATIONS SPECIFIED AS HAZARDOUS LOCATIONS.
- 3.) INSTALLATIONS SUCH AS DECORATIVE FOUNTAINS OR WATER FEATURES PROVIDED FOR VISUAL ENJOYMENT MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE ANSI/NFPA 70 AND/OR THE AUTHORITY HAVING JURISDICTION. THIS PUMP IS NOT INTENDED FOR USE IN SWIMMING POOLS, RECREATIONAL WATER PARKS, OR INSTALLATIONS IN WHICH HUMAN CONTACT WITH PUMPED MEDIA IS A COMMON OCCURRENCE.

SECTION 1A PAGE 4 DATE 1/11

