


**Sump Pumps**


**DISCHARGE** .....3/4" G.H.T. Male, Vertical  
**LIQUID TEMPERATURE** .....77°F (25°C) Continuous  
**MOTOR HOUSING** .....Thermoplastic  
**PUMP STRAINER**.....Thermoplastic  
**IMPELLER: Design** .....2 Vane, Semi-open  
**Material** .....Thermoplastic  
**SHAFT** .....Steel  
**O-RINGS** .....Buna-N  
**HARDWARE** .....Stainless Steel  
**SEAL: Design** .....Single Mechanical, Type 6  
**Material** .....Carbon/Ceramic/Buna-N  
**CORD ENTRY** .....15 ft. (4.5m) Cord with plug and pressure  
 Grommet for sealing and strain relief  
**UPPER BEARING**.....Single Row, Ball, Oil Lubricated  
**LOWER BEARING**.....Single Row, Ball, Oil Lubricated  
**MOTOR Design**.....Air-Filled  
**Insulation**.....Class B  
**SINGLE PHASE**.....Permanent Split Capacitor (PSC).  
 Includes Thermal Overload Protection  
 in Motor

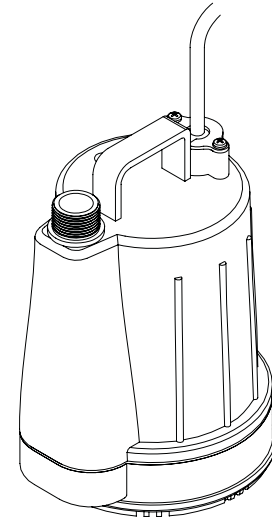

Series: UT17  
1/6 HP, 3450RPM, 60Hz


**CS**<sup>®</sup> US  
CSA 108  
UL 778  
LR16567

**DESCRIPTION:**  
GENERAL PURPOSE PUMP FOR RESIDENTIAL AND  
LIGHT INDUSTRIAL SUMP APPLICATIONS

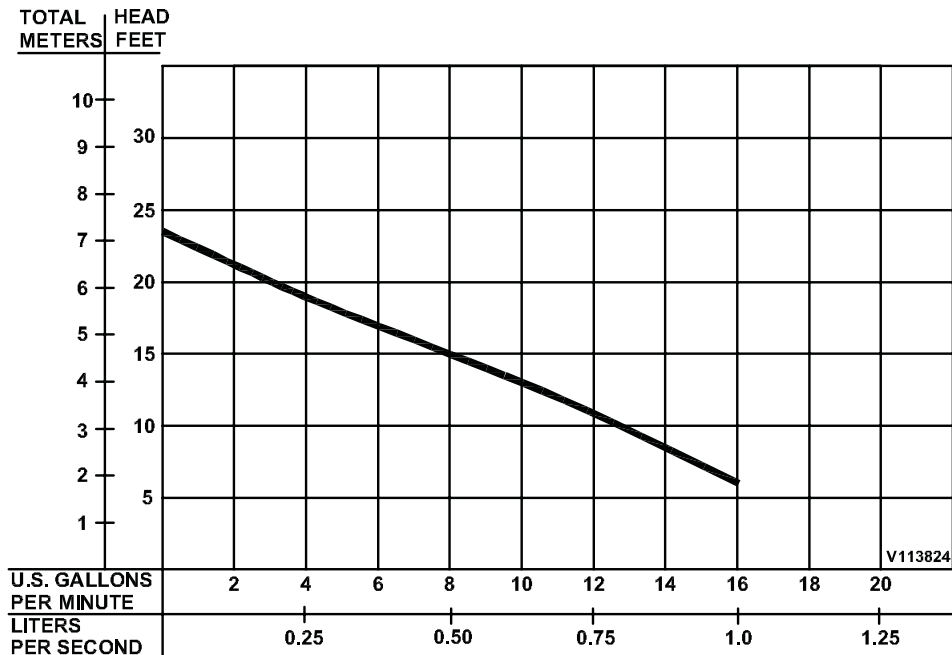

Testing is performed with water specific gravity of 1.0 @ 68°F (20°C), other fluids may vary performance

**Sump Pumps**

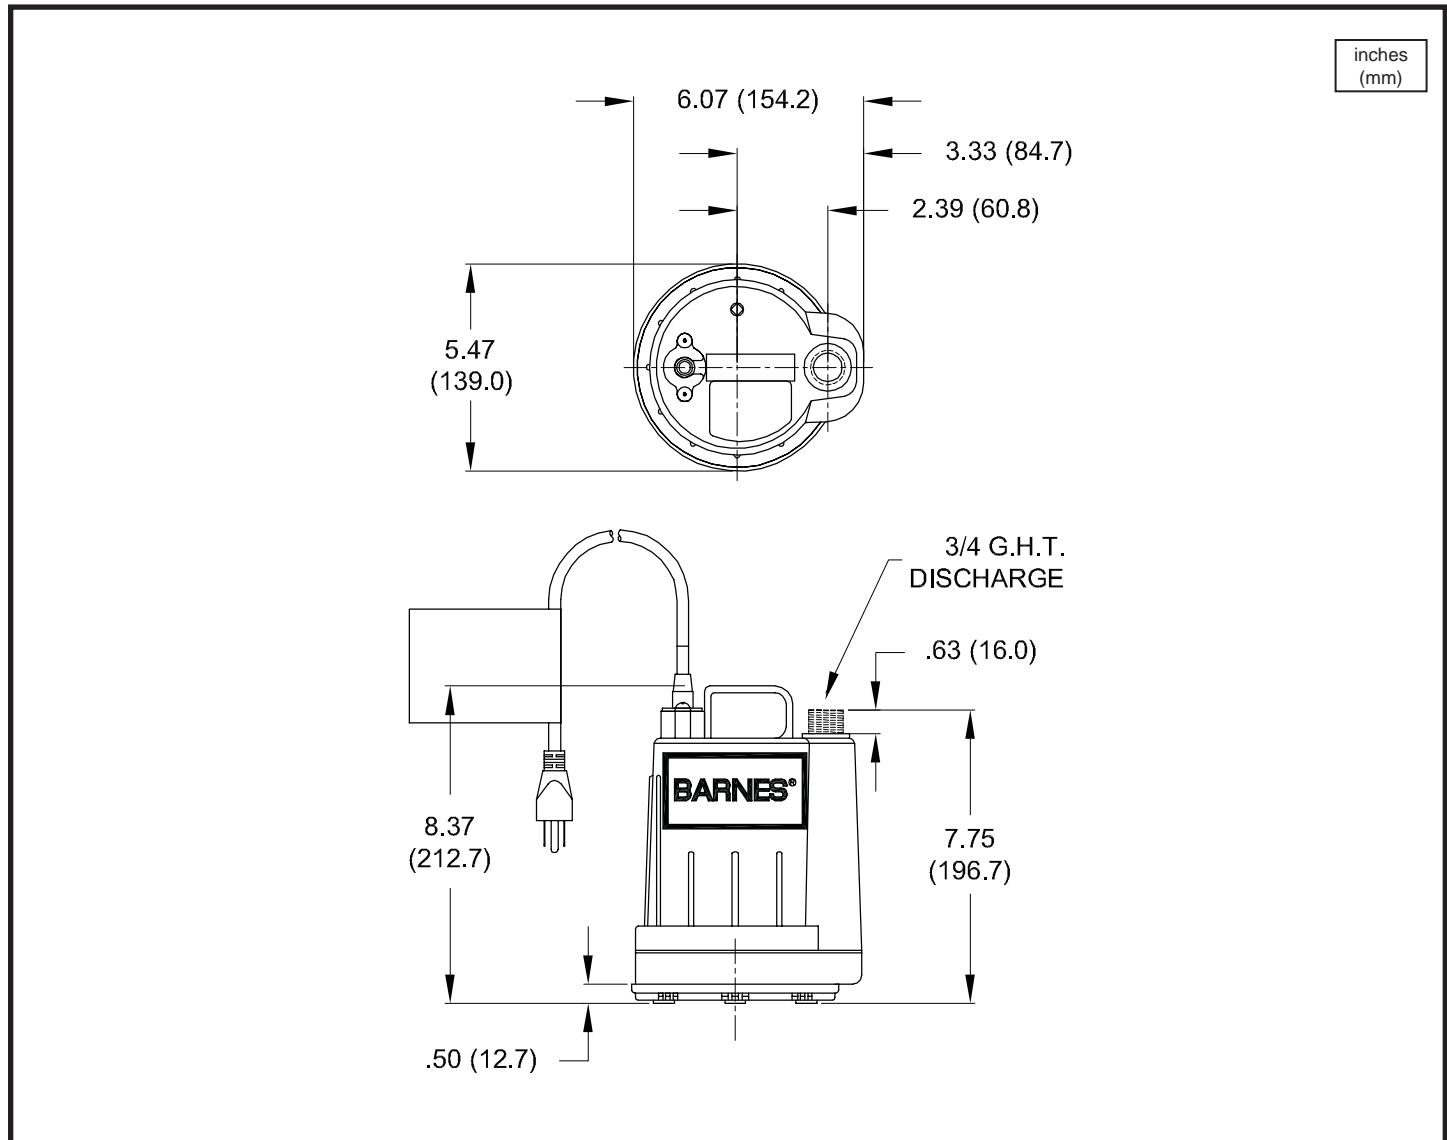

MODEL NO	PART NO	HP	VOLT/PH	Hz	RPM (Nom)	FULL LOAD AMPS	CORD LENGTH	CORD SIZE	CORD TYPE
UT17	113824	1/6	120/1	60	3450	2.0	15 ft. (4.5m)	18/3	SJTW

**IMPORTANT !**

- 1.) PUMP MAY BE OPERATED "DRY" FOR EXTENDED PERIODS WITHOUT DAMAGE TO MOTOR AND/OR SEALS.
- 2.) THIS PUMP IS APPROPRIATE FOR THOSE APPLICATIONS SPECIFIED AS CLASS I DIVISION II HAZARDOUS LOCATIONS.
- 3.) THIS PUMP IS NOT APPROPRIATE FOR THOSE APPLICATIONS SPECIFIED AS CLASS I DIVISION I HAZARDOUS LOCATIONS.
- 4.) INSTALLATIONS SUCH AS DECORATIVE FOUNTAINS OR WATER FEATURES PROVIDED FOR VISUAL ENJOYMENT MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE ANSI/NFPA 70 AND/OR THE AUTHORITY HAVING JURISDICTION. THIS PUMP IS NOT INTENDED FOR USE IN SWIMMING POOLS, RECREATIONAL WATER PARKS, OR INSTALLATIONS IN WHICH HUMAN CONTACT WITH PUMPED MEDIA IS A COMMON OCCURRENCE.